

Monitoring Relays

1-Phase True RMS AC/DC Over or Under Voltage

Type DUB71



- TRMS AC/DC over or under voltage monitoring relays
- Selection of measuring range by DIP-switches
- Measuring ranges from 0.1 to 500 V AC/DC
- Adjustable voltage on relative scale
- Adjustable hysteresis on relative scale
- Adjustable delay function (0.1 to 30 s)
- Programmable latching or inhibit at set level
- Output: 5 A SPDT relay N.D. or N.E. selectable
- For mounting on DIN-rail in accordance with DIN/EN 50 022
- 35.5 mm DIN-rail housing
- LED indication for relay, alarm and power supply ON

Product Description

DUB71 is a precise TRMS AC/DC over or under voltage (selectable by DIP-switch) monitoring relay. Owing to the built-in latch function, the ON-position of the relay output can be maintained. Inhibit function can be used to avoid relay


operation when not desired (maintenance, transitions). The LED's indicate the state of the alarm and the output relay. 35.5 mm wide housing suitable both for back and front panel mounting.

Type Selection

Mounting	Output	Measuring range	Supply: 24/48 VAC	Supply: 115/230 VAC
DIN-rail	SPDT	0.1 to 10 V AC/DC	DUB 71 C B48 10V	DUB 71 C B23 10V
DIN-rail	SPDT	2 to 500 V AC/DC	DUB 71 C B48 500V	DUB 71 C B23 500V

Ordering Key

DUB 71 C B23 10V

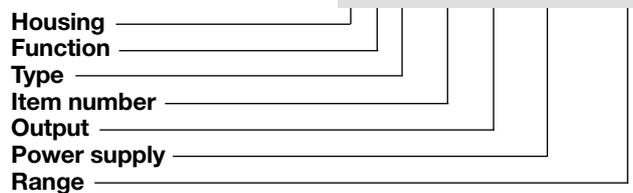

Input Specifications

Input	Terminals Y1, Y2	
Voltage level		
Measuring ranges	Internal resist.	Max. volt.
..10V:		
0.1 to 1 V AC/DC	>120 kΩ	100 V
0.2 to 2 V AC/DC	>120 kΩ	100 V
0.5 to 5 V AC/DC	>120 kΩ	100 V
1 to 10 V AC/DC	>120 kΩ	100 V
Max. voltage for 1 s		200 V
..500V:		
2 to 20 V AC/DC	500 kΩ	350 V
5 to 50 V AC/DC	500 kΩ	350 V
20 to 200 V AC/DC	500 kΩ	600 V
50 to 500 V AC/DC	500 kΩ	600 V
Max. voltage for 1 s		1000 V
Contact input	Terminals Z1, Y1	
Disabled	> 10 kΩ	
Enabled	< 500 Ω	
Latch disable	> 500 ms	

Output Specifications

Output	SPDT relay
Rated insulation voltage	250 VAC
Contact ratings (AgSnO₂)	μ
Resistive loads	AC 1
	DC 12
Small inductive loads	AC 15
	DC 13
Mechanical life	≥ 30 x 10 ⁶ operations
Electrical life	≥ 10 ⁵ operations (at 5 A, 250 V, cos φ = 1)
Operating frequency	≤ 7200 operations/h
Dielectric strength	
Dielectric voltage	2 kVAC (rms)
Rated impulse withstand volt.	4 kV (1.2/50 μs)

Supply Specifications

Power supply Rated operational voltage through terminals: A1, A2 or A3, A2	Overvoltage cat. III (IEC 60664, IEC 60038)
B48:	24/48 VAC ± 15% 45 to 65 Hz, insulated
B23:	115/230 VAC ± 15% 45 to 65 Hz, insulated
Dielectric voltage Supply to input Supply to output Input to output	AC supply 4 kV (1.2/50µs) 4 kV (1.2/50µs) 4 kV (1.2/50µs)
Rated operational power AC	3 VA

General Specifications

Power ON delay	1 s ± 0.5 s or 6 s ± 0.5 s
Reaction time Alarm ON delay Alarm OFF delay	(input signal variation from -20% to +20% or from +20% to -20% of set value) < 100 ms < 100 ms
Accuracy Temperature drift Delay ON alarm Repeatability	(15 min warm-up time) ± 1000 ppm/°C ± 10% on set value ± 50 ms ± 0.5% on full-scale
Indication for Power supply ON Alarm ON Output relay ON	LED, green LED, red (flashing 2 Hz during delay time) LED, yellow
Environment Degree of protection Pollution degree Operating temperature Storage temperature	IP 20 3 -20 to 60°C, R.H. < 95% -30 to 80°C, R.H. < 95%
Housing dimensions	35.5 x 81.5 x 67 mm
Weight	Approx. 150 g
Screw terminals Tightening torque	Max. 0.5 Nm acc. to IEC 60947
Approvals	UL, CSA
CE Marking	Yes
EMC Immunity Emission	Electromagnetic Compatibility According to EN 61000-6-2 According to EN 50081-1

Mode of Operation

DUB71 monitor both AC and DC over or under voltage.

Example 1

(no connection between terminals Z1, Y1 - latch function disabled)

The relay operates when the measured value exceeds (or drops below) the set level for more than the set delay time. It releases when the voltage drops below (or exceeds) the set level (see hysteresis setting), or when power supply is interrupted.

Example 2

(connection between terminals Z1, Y1 - latch function enabled)

The relay operates and latches in operating position when the measured value

exceeds (or drops below) the set level for more than the set delay time.


Provided that the voltage has dropped below (or has exceeded) the set point (see hysteresis setting) the relay releases when the interconnection between terminals Z1, Y1 is interrupted, or power supply is interrupted as well.

The yellow LED flashes until the delay time has expired or the measured value has dropped below the set point (see hysteresis setting).

Note

When the inhibit contact is opened, if the input signal is already in alarm position, the delay time needs to elapse before relay activation.

Wiring Diagrams

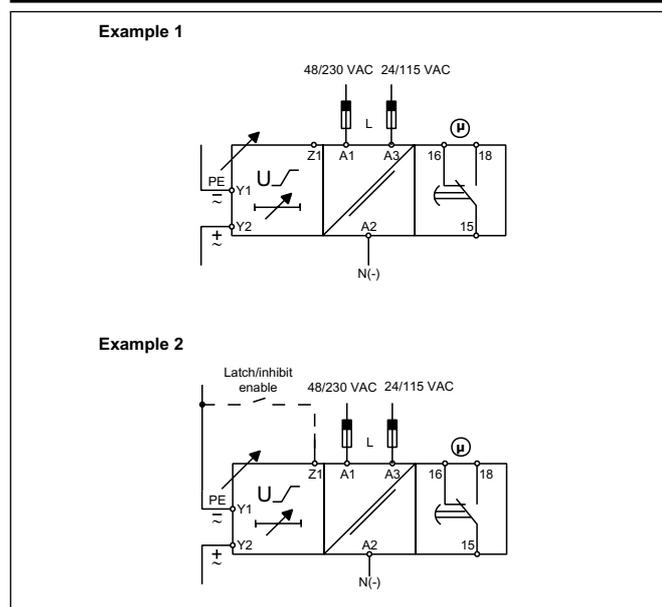

Function/Range/Level and Time Delay Setting

Adjust the input range setting the DIP switches 1 and 2 as shown below.

To access the DIP switches open the grey plastic cover as shown below.



Select the desired function setting the DIP switches 3 to 6 as shown below.

Selection of level and time delay:

Upper knob: Setting of hysteresis on relative scale: 0 to 30% on set value.


Centre knob: Voltage level setting on relative scale: 10 to 110% on full scale.

Lower knob: Setting of delay on alarm time on absolute scale (0.1 to 30 s).

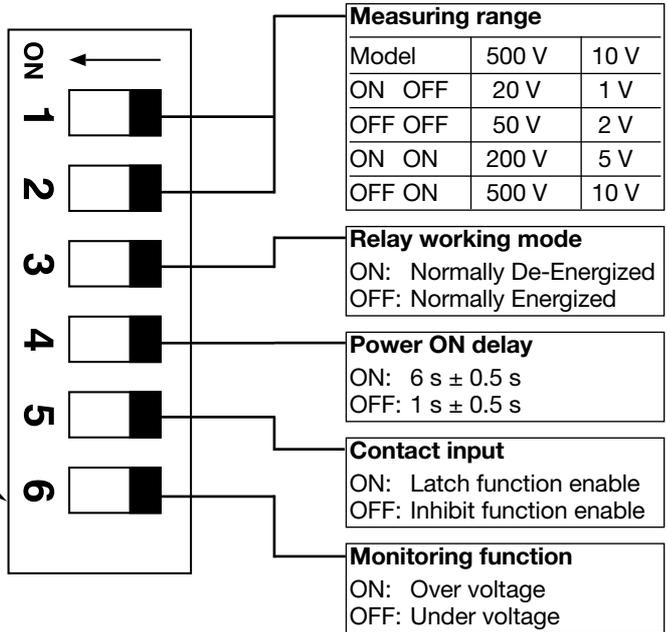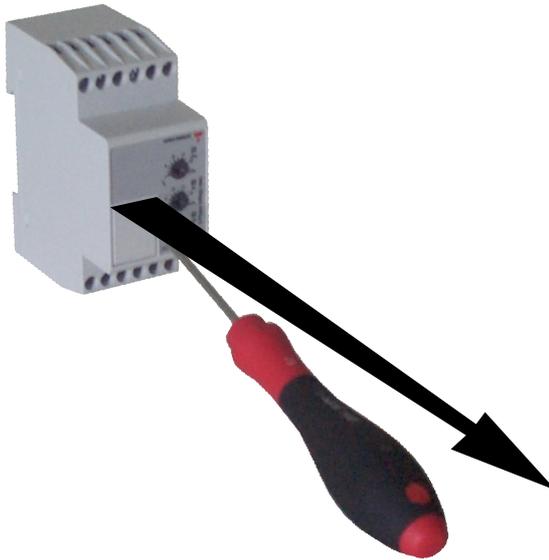


Operation Diagrams


Over voltage - N.D. relay

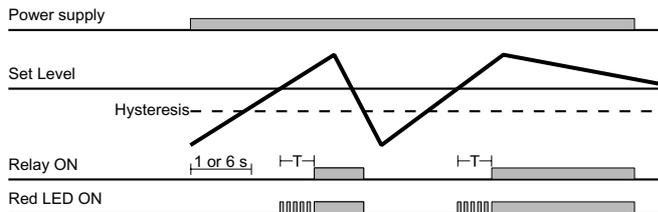

Under voltage - Latch function - N.D. relay

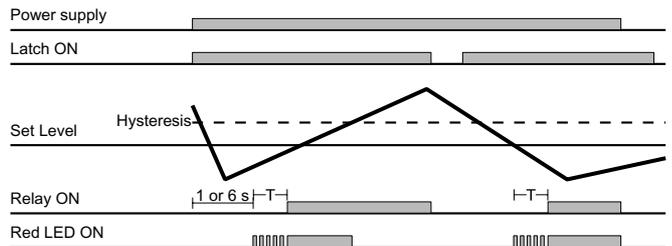

Under voltage - N.D. relay

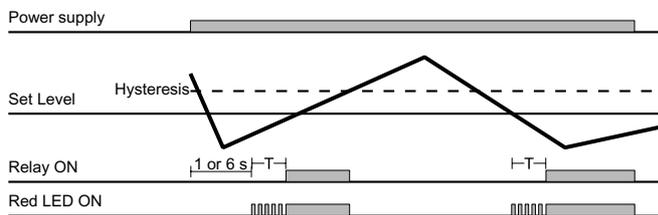

Over voltage - Inhibit function - N.D. relay

